


plan

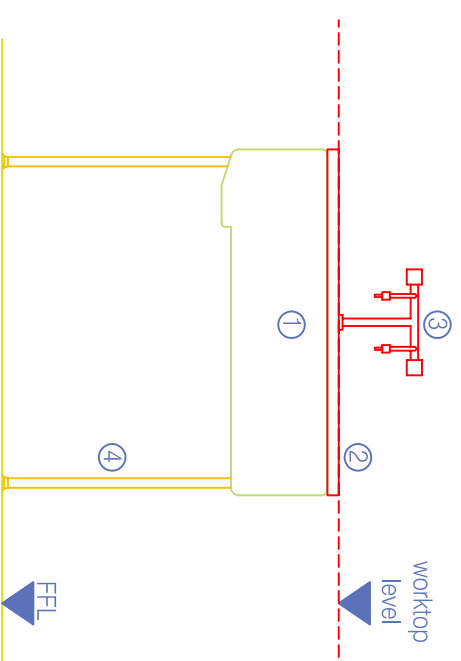

elevation a-a

- Legend
1. Belfast type fireclay sink 900 x 460 x 250 mm with gap between sink and wall to allow for pipe rises.
 2. Lacquered hardwood cover piece 900 x 105 (approx) x 32 mm thick to finish gap between wall and sink - cantilever over sink by 10 mm with drip groove. Supported by 50 x 25 mm SW batten.
 3. Science Rooms: Science taps with water supply rising from low level behind sink, as fed from behind. Dilution pot as science pedestal unit. All other rooms to have chrome plated bottle trap.
 4. Polished stainless steel legs and wall bearers as supplied by sink manufacturer with adjustable feet.
 5. Hardwood filler piece closing off space between sink and wall - In elevation.

Note: where sink is set into worktop, the filler piece to be continuous with worktop and to match the worktop finish e.g. science rooms.

Minimum Standards for materials and finishes:

Core material for worktops, doors and carcasses:
 Dry Fibre Board (MDF) to I.S. EN 622-5 Class E1 formaldehyde content tested to EN 120.
 Moisture resistant board to I.S. EN 622-5 MDF-H, class E1 formaldehyde content tested to EN 120.

Core materials to be finished with plastic laminates to comply with I.S. EN 438, grade HGS/HGP (including vertical panels, shelves and doors).
 Balancing laminate to be used in all cases.

Edges of all laminated panels (if not postformed) to be finished with solid colour laminate (2 mm thickness), PVC or hardwood edges to seal all edges.


Solid timber to comply with IS EN 942, Class J10.
 FSC/PEFC chain of custody certification required for all timber and timber products, including MDF.

Metal frames:
 Generally 60x30 mm mild steel frame with welded end caps and adjustable feet. Epoxy powder coated to selected RAL colour.

Ironmongery:
 Stainless steel door handles, reversed fixed through doors. High quality stainless steel or nickel plated self-closing hinges (180°) and high quality cylinder style lock on masterkey system to suit the school's requirements.

Hardwood plinth size to be coordinated with skirting height in rooms.

Note:
 Alternative materials and finishes of equal or higher specification and performance are permitted.
 Drawings to be read in conjunction with specification.

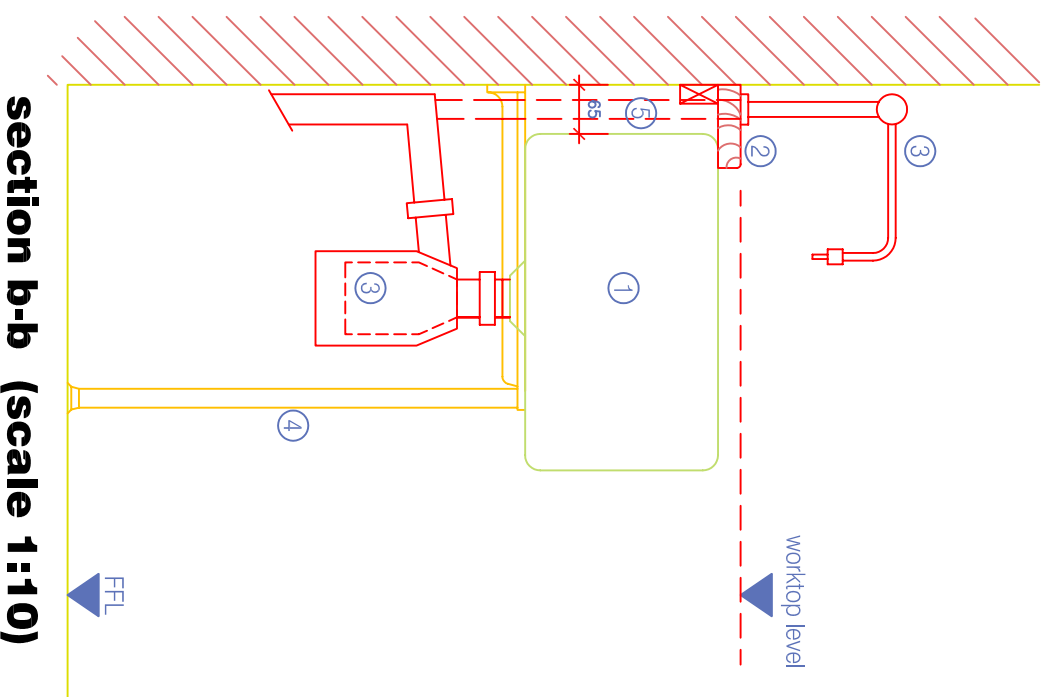

section b-b (scale 1:10)

BELFAST SINK - BS

SCALE:	1:10/1:20
DRG No:	008
DATE:	JUNE '09
CHECKED BY :	-
PREPARED BY:	-
REVISION:	
REMARKS:	

